

# Intelligent Manual Call Point



## Product Overview

Product Type	Manual Call Point
Part No.	SA5900-908APO (Red)
	SA5900-903APO (White)
	SA5900-904APO (Yellow)
	SA5900-905APO (Blue)
	SA5900-906APO (Green)
	SA5900-907APO (Orange)
Digital Communication Protocol	CoreProtocol™, Discovery & XP95 compatible

## Product Information

The Intelligent Manual Call Point has been designed to operate on a loop of intelligent fire detection devices. An alarm is initiated by pressing the resettable element. The manual call point signals to the Control and Indicating Equipment using an interrupt feature within the Apollo Digital Protocol. An alarm status is indicated through the rotation of the resettable element, displaying yellow and black indication bars and a solid red LED. The manual call point can be easily reset from the front using the supplied reset key.

- Resettable operating element
- Easy access, front reset mechanism
- E-Z fit connector system for installation
- Ergonomic reset key
- EN 54-11 & EN 54-17 Certified (Red version only)
- 170° viewable LED
- Continuity link for cable insulation testing
- Suitable for semi flush or surface mounting

## Technical Data

<b>Supply voltage</b>	17-35V DC
<b>Digital Communications Protocol</b>	CoreProtocol, Discovery & XP95 compatible 5-13V Peak to Peak
<b>Current Consumption (max) at 24V DC</b>	
<b>Power Up Surge (1s typical)</b>	1mA
<b>Quiescent</b>	100µA
<b>Alarm current (LED On)</b>	4mA
<b>Operating temperature</b>	-40°C to 70°C
<b>Humidity</b>	0% to 95%RH (no condensation or icing)
<b>Vibration, impact and shock</b>	EN 54-11 & EN 54-17 (Red version only)
<b>IP Rating</b>	IP44
<b>Approvals &amp; standards</b>	EN 54-11, EN 54-17, CPR & LPCB (Red version only)
<b>Dimensions</b>	90mm height x 90mm width x 63mm depth
<b>Weight</b>	180g

## Protocol Compatibility

The Intelligent Manual Call Point will operate with compatible Apollo control equipment using the digital XP95, Discovery and CoreProtocols.

## Electrical Consideration

The Intelligent Manual Call Point is loop powered and operates at 17-35V DC for all variants.

## Operating Principles

The address of each call point is set at the commissioning stage by means of a DIL switch.

A solid red alarm LED is provided on the manual call point. This LED is controlled independently of the call point, by the control panel. The LED will flash yellow if there is a fault and flash green when the device is polled. Discovery and CoreProtocol configurable.


Once activated, the Intelligent Manual Call Point can be reset by inserting the reset key into the front facing LED, turning clockwise until a positive click and reset occurs.

The Intelligent Manual Call Point incorporates a short circuit isolator which will ensure its operation in the event of a short circuit fault on the loop. Isolator operation is indicated by a solid yellow LED. For further details of the isolator refer to data sheet PP2090, available on request.


This manual call point helps reduce installation time as all the initial installation cabling is wired to a removable terminal block which fits neatly in the back of the manual call point.

# Intelligent Manual Call Point

Protocol Usage	
<b>Output Bits</b>	
2	Red LED
1	Electronic Self Test
0	Not Used
<b>Interrupt</b>	Yes
<b>Analogue Value</b>	
16	Quiescent
64	Alarm
4	General Fault
1	Switch Fault
<b>Input Bits</b>	
2	LED Confirmed
1	0=Alarm 1=Quiescent
0	1=Alarm 0= Quiescent
<b>Flag Settings</b>	
<b>XP95 Flag</b>	Yes
<b>Alarm Flag</b>	No

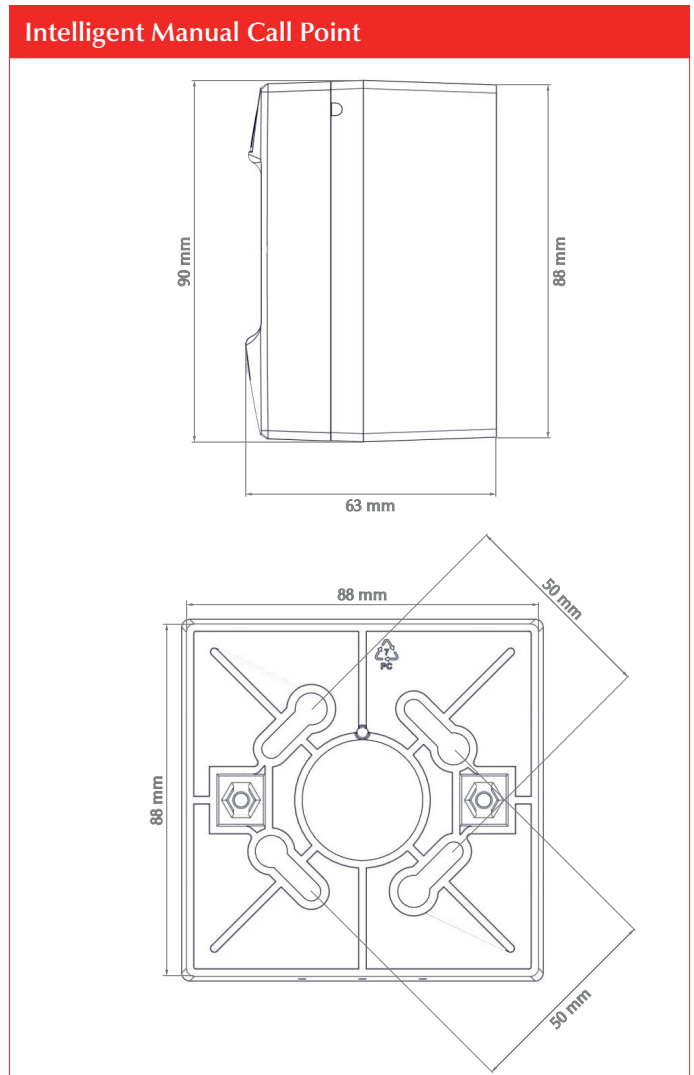

Intelligent Manual Call Point Response Characteristics  
Analogue Value (Counts)

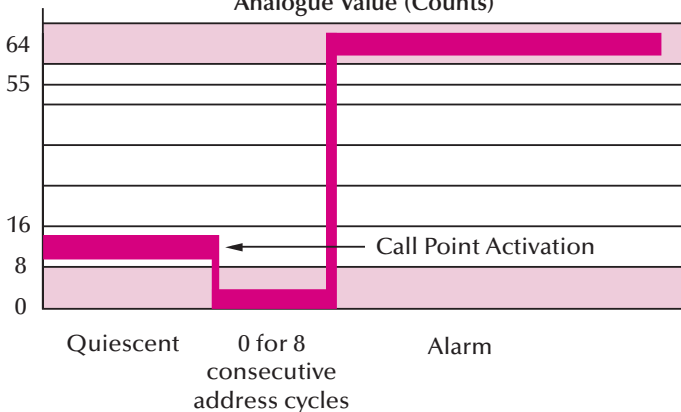

## Mechanical Construction

The component parts of the call point are moulded in a robust fire retardant polycarbonate.

## EMC Directive 2004/108/EC

The Intelligent Manual Call Point complies with the essential requirements of the EMC Directive 2004/108/EC, provided that it is used as described in this data sheet.

A copy of the Declaration of Conformity is available from Apollo on request.

Conformity of the Intelligent Manual Call Point with the EMC Directive does not confer compliance with the directive on any apparatus or systems connected to it.

## Construction Products Regulation 305/2011

The Intelligent Manual Call Point complies with the essential requirements of the Construction Products Regulation 305/2011.

A copy of the Declaration of Performance is available from Apollo on request.



INVESTORS  
IN PEOPLE

A HALMA COMPANY

