

# XP95

## Zone Monitor with Isolator



### Product overview

Product	Zone Monitor with Isolator
Part No.	55000-845
Digital communication	XP95 (Discovery and CoreProtocol compatible)

### Compliance



### Product information

The XP95 Zone Monitor with Isolator powers and controls the operation of a zone of up to 20 Orbis/Series 65 Apollo fire detectors from the Apollo loop and is for indoor use only.

#### Features

The XP95 Zone Monitor with Isolator returns a preset analogue value when all detectors on the zone are in quiescent state. A different value is returned when a detector changes to the alarm state. The Zone Monitor with Isolator latches in the alarm state.

The Zone Monitor with Isolator is fitted with a bi-directional short circuit isolator and will be unaffected by loop short-circuits on either the loop input or loop output.

Two LEDs, one red and one yellow, are visible through the front cover of the enclosure. The red LED is illuminated to indicate that a fire alarm condition has been detected on the zone wiring. The yellow LED is illuminated whenever the built-in isolator has sensed a short-circuit loop fault.

### Technical data

All data is supplied subject to change without notice. Specifications are typical at 24 V, +25°C and 50% RH unless otherwise stated.

Supply Voltage	17 V-28 V dc with protocol pulses of 5 - 9 V dc.
Zone voltage (Loop voltage 22 V)	19 V ± 1 V
(Loop voltage < 22 V)	Loop voltage - 1.5 V
Maximum current consumption at 24V (5.1 kΩ EOL):	
Switch-on surge, 150 ms max	3.5 mA
Quiescent	4 mA plus detector load
Alarm	11 mA (19 mA when increased current enabled)
Short circuit	11 mA
End-of-line resistor value	5.1 k ± 5% 1/3 W
Stabilisation time on power-up	4 seconds
Maximum capacitor on zone terminals	50 µF
Operating temperature	-20 °C to +70 °C
Humidity (no condensation)	0% to 95% RH
Standards and Approvals	CPR, LPCB, VdS, VNIIP0, FG, CCCf and CCMG
IP Rating	IP54
Dimensions	150 mm wide x 90 mm height x 48 mm deep
Weight	230 g
Materials	White flame retardant polycarbonate

### EMC Directive 2014/30/EU

The XP95 Zone Monitor with Isolator complies with the essential requirements of the EMC Directive 2014/30/EU, provided that it is used as described in this datasheet.

A copy of the Declaration of Conformity is available from the Apollo website: [www.apollo-fire.co.uk](http://www.apollo-fire.co.uk)


Conformity of the XP95 Zone Monitor with Isolator with the EMC Directive, does not confer compliance with the directive on any apparatus or systems connected to it.

### Construction Products Regulation 305/2011/EU


The XP95 Zone Monitor with Isolator complies with the essential requirements of the Construction Products Regulation 305/2011/EU.

A copy of the Declaration of Performance is available from the Apollo website: [www.apollo-fire.co.uk](http://www.apollo-fire.co.uk)

Loop connections

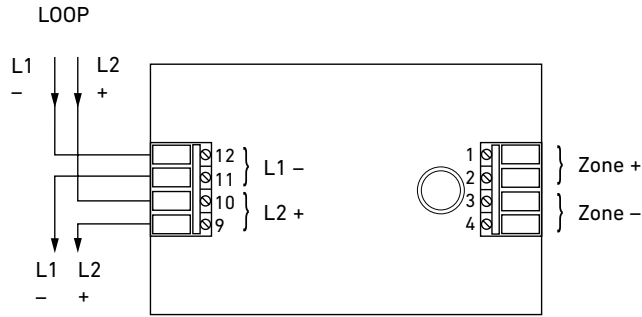

Zone connections - standard bases with 5.1kΩ monitoring resistor at end of line

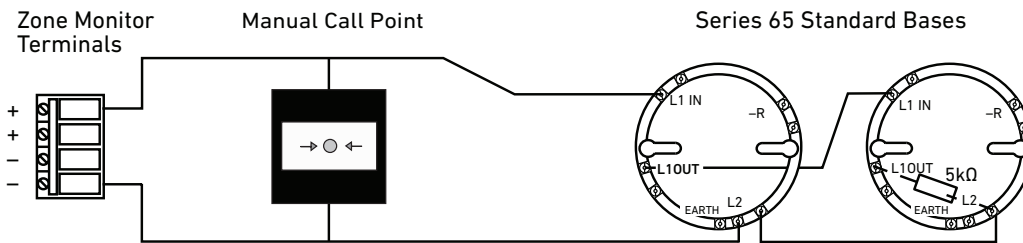

**Note:**  
If a 5kΩ is used for monitoring all MCPs must be connected between the zone monitor unit and the first detector

Zone connection - diode bases with active EOL device

